



CALDWELL COUNTY SHERIFF'S OFFICE

**** SHERIFF ALAN C. JONES ****

2351 MORGANTON BLVD. SW * LENOIR, NC 28645

PHONE: 828-758-2324 * FAX: 828-757-8685

Permit No.	Scan Date	DIN
1401-MSWLF-1975	July 9, 2015	24702


RECEIVED
July 8, 2015
 Solid Waste Section
 Asheville Regional Office

Caldwell County Health Department 2345 Morganton Blvd. Lenoir NC 28645
 Onsite Water Protection Permit P: (828) 426-8579 Fax: (828) 757-6864

<input checked="" type="checkbox"/> Improvement Permit	<input type="checkbox"/> Construction Authorization	Permit # 23811
<input checked="" type="checkbox"/> New System	<input type="checkbox"/> Expansion	Lot size: 100 + (sq. ft.)
<input type="checkbox"/> Repair	PIN # 2779144763	Section: -
Issued to: Caldwell County		Subdivision: -
Address of the Property: 1200 Dragstrip Rd		
Directions to site: Dragstrip Rd past Lick Mountain Village, firing range on right		
Facility Type: Classroom & firing range	# of Bedrooms: -	Basement: Yes <input checked="" type="checkbox"/> Basement Fixtures: Yes <input checked="" type="checkbox"/>
Design Wastewater Flow: 100 (gal/day)	Type of Water Supply: Public	Expiration Date: 5 yrs

The issuance of this permit by CCHD in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This permit is subject to revocation if the site plan, plat, or intended use changes. I accept the system type and site plan/layout as specified on the IP/CA.


Applicant / Legal Representative Signature: *[Signature]* Date: **7/7/15**

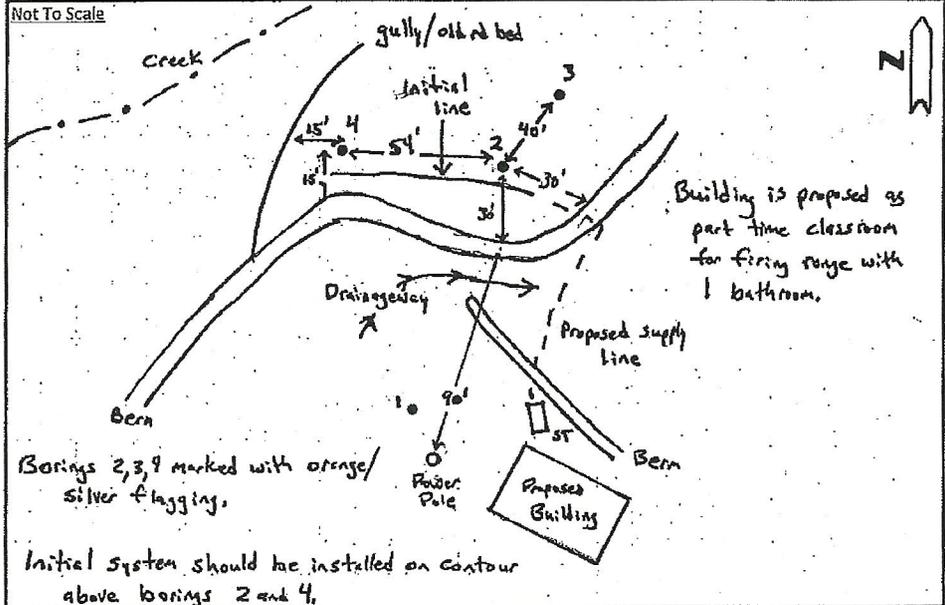

Initial: 25% reduction	Repair: 25% reduction					
Total Length: 63 (ft.)	Trench Width: 36 (in.)	Min. Spacing: 9 (ft.) on center	Max Trench Depth: 27 (in.) low side	Septic Tank: 750 min (gal.)	Pump Tank: - (gal.)	Distribution: -
Common setbacks: Well: 100 (ft.)	Spring: 50 (ft.)	Building Foundation: 5 (ft.)	Property Line: 10 (ft.)	Waterline: 10 (ft.)	Cutbank: 15 (ft.)	Stream: 50 (ft.)

- Installation Requirements:
- 1) A valid CA is required for system installation. Contractors must call CCHD between 8-9am to schedule final inspections.
 - 2) Nitrification lines represent approximate contours only. The contractor must flag the system within the approved area prior to beginning the installation to ensure proper grade, trench depth, and spacing is maintained.
 - 3) The construction and installation requirement of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by reference into this permit and shall be met.
 - 4) Systems shall be installed in accordance with the system layout depicted on the CA.
 - 5) If you have questions regarding any of the permit conditions or installation requirements contact CCHD at 828-426-8579.

REHS Signature: *[Signature]* Issue Date: **7/16/15**

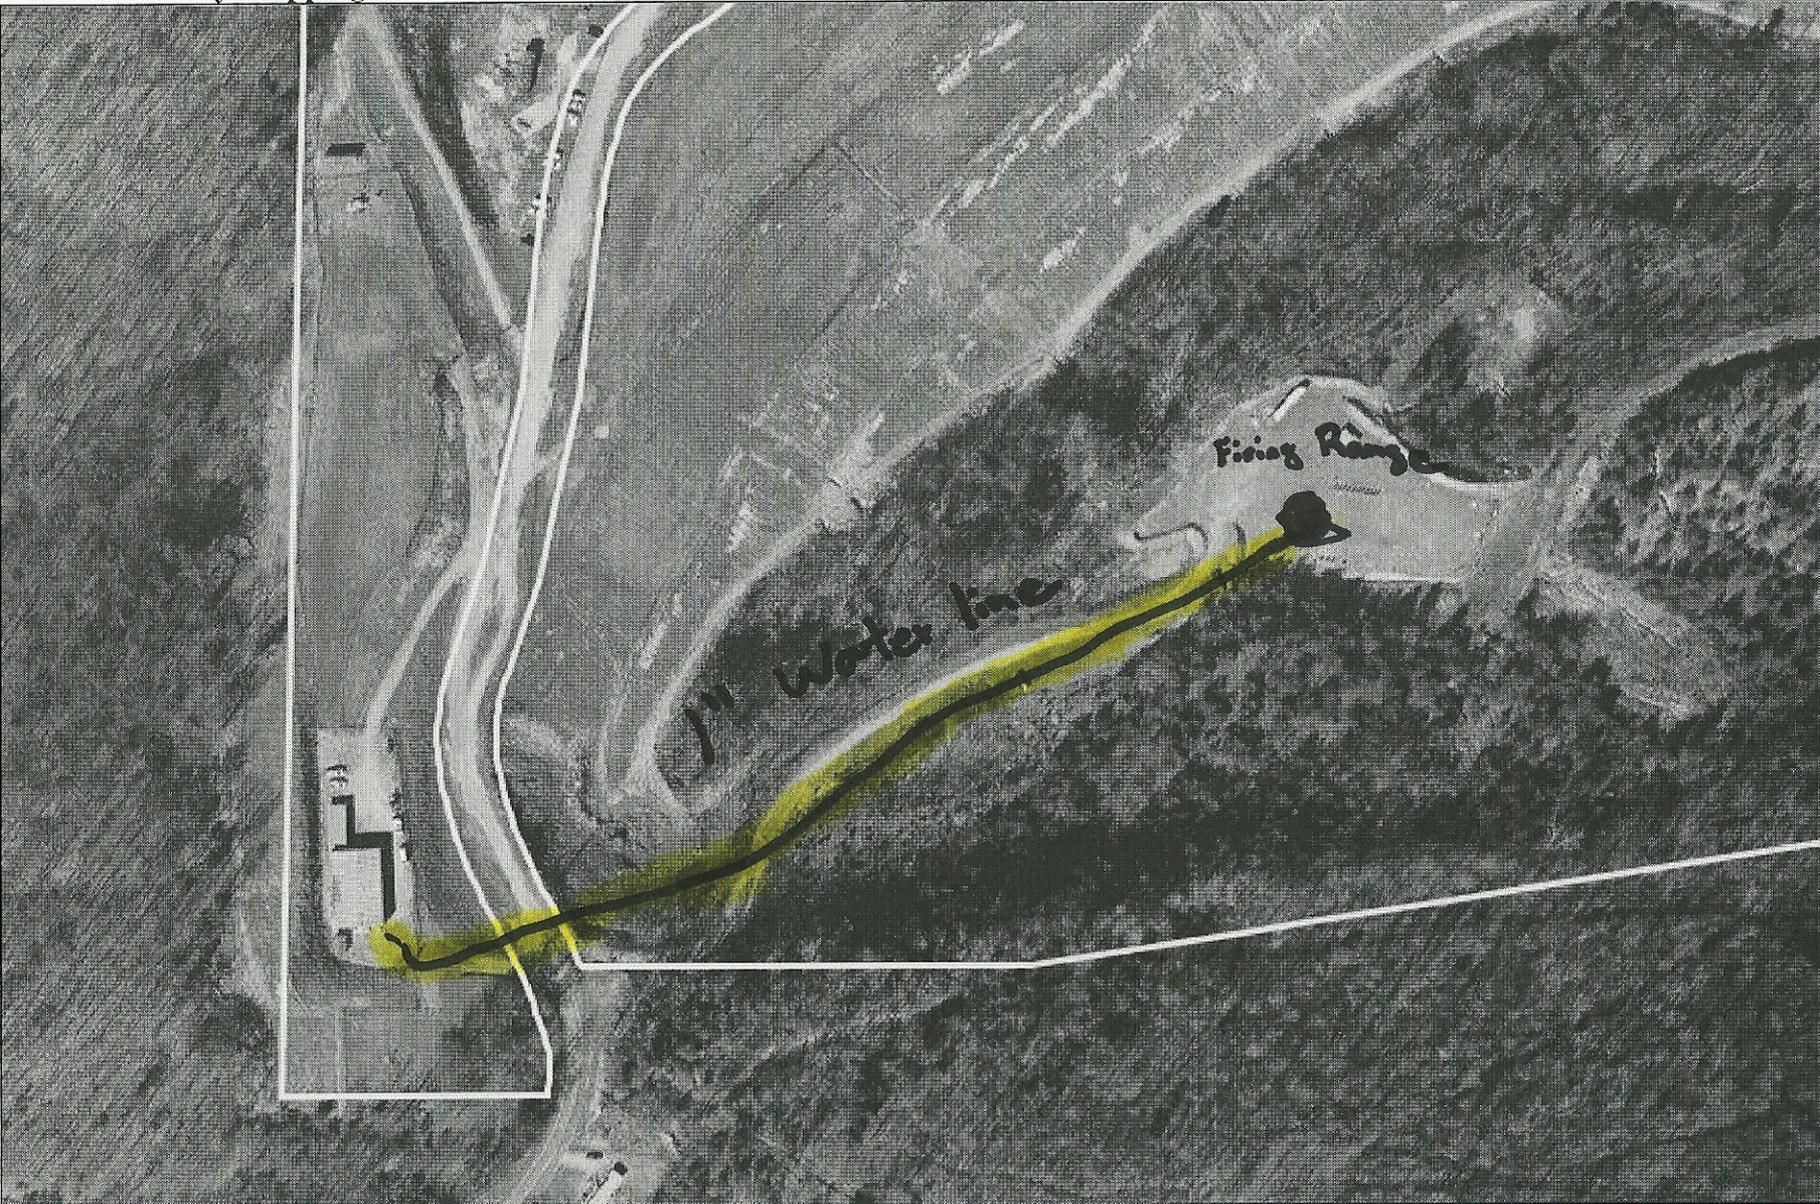

11 Water line

Fishing Range