


Bobby's Backhoe Service, Inc.

1324 WILEY LEWIS ROAD
GREENSBORO, N.C. 27406
(919) 275-1286

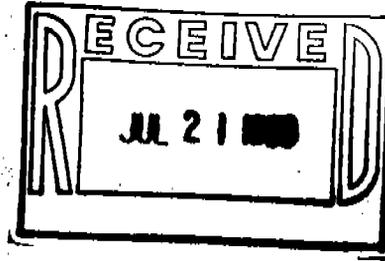

Greensboro County
P.O. Box 18807
Greensboro, N.C. 27419

Date: July 19, 1993

Project Name: Phillips Management

Address: 6205 Swing Ct.

Date tank(s) removed: 6-15-93

Depth of tank: 9' 4" - top of tank 4' from ground

Soil Sample Depth: 12' deep on E + W ends.

Any Signs of Leakage: NO

Lab samples taken to: Research + Analytical, Kernersville, N.C.

Disposal Of Tank: Safeway Tank, Colfax, N.C.

Size of Tank: 18' x 64"

Other Comments:

The soil sample was taken from
Backhoe Bucket, and placed in sterilized jars from
lab. Taken to lab on ice.

Leresa Dixon

(GW/UST-3)

Notice of Intent: UST Permanent Closure or Change-in-Service

RESERVED

FOR TANKS IN NC

Return Completed Form To: The appropriate DEM Regional Office according to the county of the facility's location. [SEE REVERSE SIDE OF OWNER'S COPY (PINK) FOR REGIONAL OFFICE ADDRESS].

State Use Only N.C. Dept. of EHM I. D. Number APR 21 1993 Date Received

Winston Salem Regional Office

INSTRUCTIONS

Complete and return thirty (30) days prior to closure or change-in-service.

I. OWNERSHIP OF TANK(S)

Tank Owner Name: Phillips Management (Corporation, Individual, Public Agency, or Other Entity) Street Address: P.O. Box 9515 County: Guilford City: Greensboro State: NC Zip Code: 27429 Tele. No. (Area Code): 919-274-2481

II. LOCATION OF TANK(S)

Facility Name or Company: Phillips Management Facility ID # (if available): Street Address or State Road: 6805 SWING CT. County: Guilford City: Greensboro Zip Code: Tele. No. (Area Code): 919-274-2481

III. CONTACT PERSON

Name: Keith Phillips Job Title: OWNER Telephone Number: 919 274 2481

IV. TANK REMOVAL, CLOSURE IN PLACE, CHANGE-IN-SERVICE

- 1. Contact Local Fire Marshall. 2. Plan the entire closure event. 3. Conduct Site Soil Assessments. 4. If Removing Tanks or Closing in Place refer to API Publications. 2015 "Cleaning Petroleum Storage Tanks" & 1604 "Removal & Disposal of Used Underground Petroleum Storage Tanks". 5. Provide a sketch locating piping, tanks and soil sampling locations. 6. Fill out form GW/UST-2 "Site Investigation Report for Permanent Closure" and return within 30 days following the site investigation. 7. Keep records for 3 years.

V. WORK TO BE PERFORMED BY:

(Contractor) Name: Bobbys Backhoe Ser. INC Address: 1324 Wicky Lewis Rd State: GORO NC Zip Code: 27406 Contact: Bobby Williams / Teresa Dixon Phone: 919-275-1286


VI. TANK(S) SCHEDULED FOR CLOSURE OR CHANGE-IN-SERVICE

Table with columns: TANK ID#, TANK CAPACITY, LAST CONTENTS, PROPOSED ACTIVITY (CLOSURE, CHANGE-IN-SERVICE). Row 1: 1, 1000, GAS, [X] under Removal, [] under Abandonment In Place, [] under New Contents Stored.

VII. OWNER OR OWNER'S AUTHORIZED REPRESENTATIVE

Print name and official title: TERESA DIXON Office Manager Signature: Teresa Dixon Scheduled Removal Date: 5-20-93 Date Submitted: 4-20-93

*If scheduled work date changes, notify your appropriate DEM Regional Office 48 hours prior to originally scheduled date.



RESEARCH & ANALYTICAL LABORATORIES, INC.

Analytical/Process Consultations
Phone (919) 996-2841

CHAIN OF CUSTODY RECORD

WATER/WASTEWATER

MISC.

JOB NO.

PROJECT NAME

Perkins Pipeline Service, Inc.
100 S. ...
Charlotte, NC 27406

SAMPLERS (SIGNATURE)

Charles ...
6305 ...
Durham, N.C.

SAMPLE NO.

DATE

TIME

CONF. LAB.

STATION LOCATION

NO. OF CONTAINERS

- 2L G (BNA, Herb./Pest.)
- 2 40ml Vials (VOA)
- 250ml G (TOX)
- 250ml P (TOC)
- 1L PG (BOD, TSS, Unpreserved, etc.)
- 1L G (Phenol, Oil & Grease)
- 1L PG (COD, N,P)
- 1L PG (Metals, Hardness)
- 1L PG (CYANIDE)
- Sterile PG (Coliform)

REQUESTED ANALYSIS

3000 ① E and 6-15-93 11:00
3000 ② W and 6-15-93 11:00
3000 170563-1
170564-2

QAS
QAS

5230
8030

RELINQUISHED BY

DATE/TIME

RECEIVED BY

REMARKS:

Dean Davis

6/5/93

Charles ...

on ice

01

FILE NUMBER
6710

GREENSBORO FIRE DEPARTMENT

FIRE INSPECTION REPORT

STREET NUMBER 6205	DIR	STREET NAME SW NB	TYPE CT	BUILDING UNIT	GENERAL INSP. DATE							
LAST INSP. DATE	BC OCCUPANCY 38 40	HAZ OCCUPANCY 41 43 44 45	CONST 46	SPRINKLERS 47	STAND PIPES 48	DETECTORS 49	ALARM SYS 50	SPEC SYS 51	YR. CONST. 52 53	STORIES 54 55	FIRE EXT. 56	L-LINE P-PREV. 57
LAST INSP. BY	SO. FT. GROUND FLOOR 58	MAX. OCCUPANT LOAD 63 64 67	REQ EXITS 68	SPEC INSTR 69	DUE DATE 70	INSPECTION PERIOD 75 76 77	DISTRICT 78 79	80				

02

DATE 06/15/93	TIME	ACTY ID	DISTRICT 02	SHFT PC	INSPECTING OFFICER 33
------------------	------	------------	----------------	------------	--------------------------

03

NOTICE OF FIRE & SAFETY HAZARDS: You are hereby notified that an inspection of your premises has disclosed the following fire safety hazards and/or violations of the provisions of appropriate local or state codes.

CODE	TYPE	COUNT	DESCRIPTION	APPR.
			Observed removal of 2-1000 gal gasoline tank. O ₂ reading 7.3%.	
			Bobby's Back has pulling tank and taking sample. Tank properly labeled, loaded and transported to Deferonny for disposal. Tank appeared to be in good shape. O ₂ - 7.3%.	

ORDER TO COMPLY: As such conditions are contrary to law, you are hereby required to correct said conditions immediately upon receipt of this notice. An inspection to determine whether you have complied will be conducted on or before Failure to comply with the foregoing order before the date of such reinspection may render you liable to the penalties provided by law for such violation. FIRE PREVENTION BUREAU - PHONE 373-2177

REINSPECTION DATE

X *[Signature]*
OCCUPANT

X *[Signature]*
INSPECTING OFFICER


04

BUSINESS NAME BRAD R GAN INC	BUSINESS PHONE
OWNER/OCCUPANT	EMERGENCY PHONE

05

BUILDING UNIT IDENTIFICATION

OCCUPANT'S COPY



RESEARCH & ANALYTICAL LABORATORIES, INC.

Analytical/Process Consultations

NC CERT #02

28 June 1993

Bobby's Backhoe Service, Inc.
1324 Wiley Lewis Road
Greensboro, North Carolina 27406


Attention: Teresa Dixon

Project Name:

Phillips Management

<u>Sample Number</u>	<u>Date Taken</u>	<u>Time (hrs)</u>	<u>RAL Sample#</u>	<u>EPA Method*</u>	<u>Results (PPM)</u>
1 E end	6/15/93	1100	170563	5030	<10
2 W end	6/15/93	1100	170564	5030	<10

*EPA Method 5030 = Total Petroleum Hydrocarbons as Gasoline
PPM = Parts per million
< = Less than

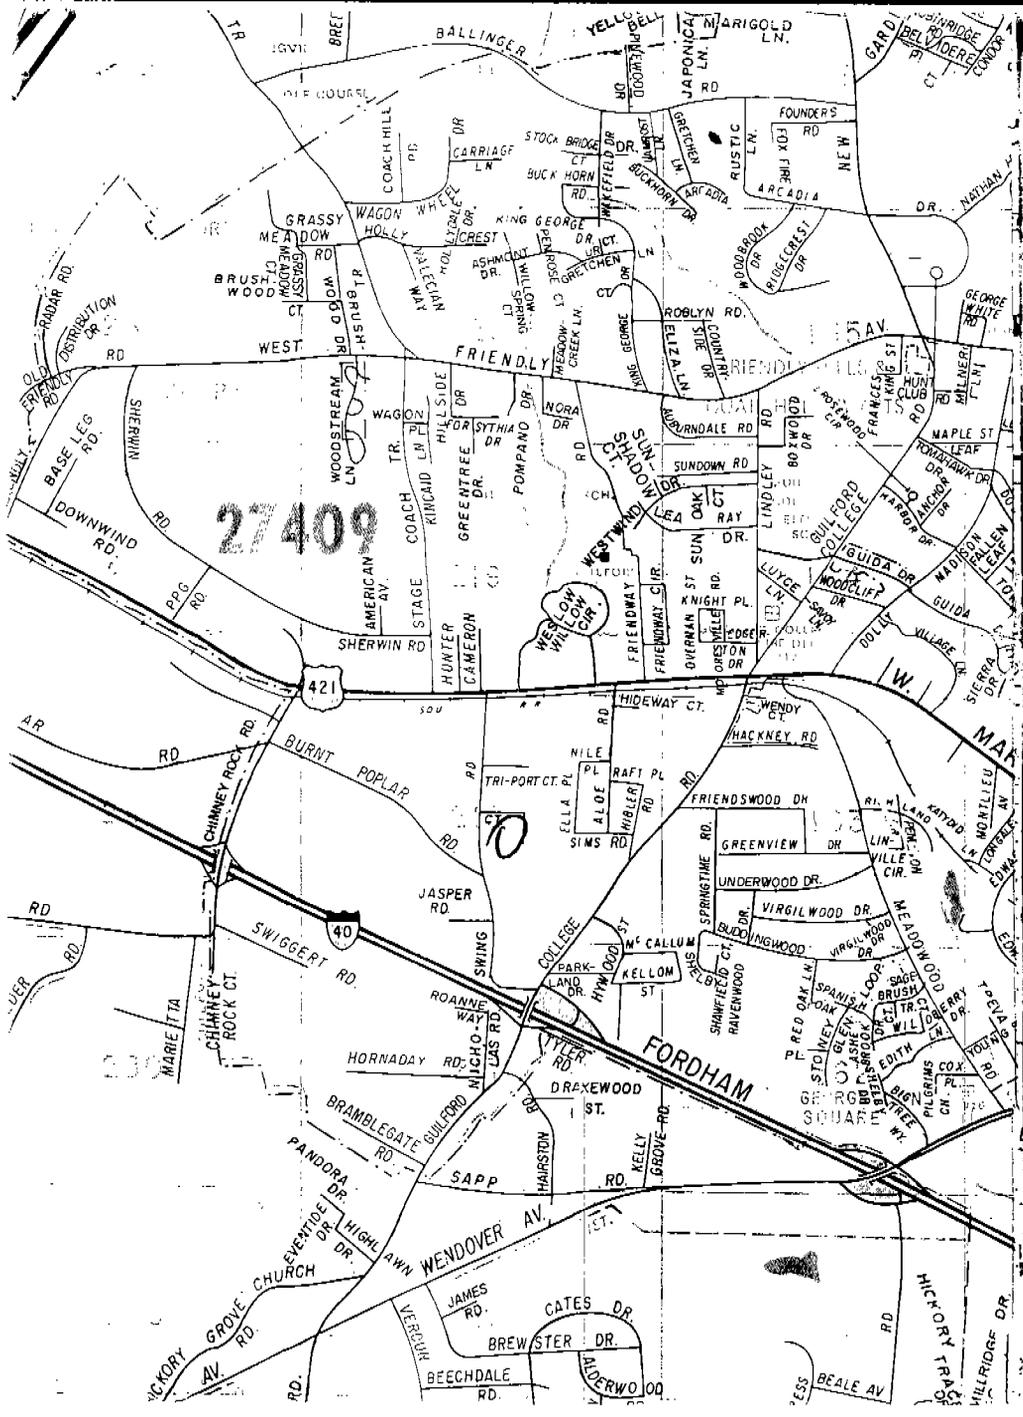

27409

0

FORDHAM

W. W. MAR

W. W. MAR

WICKORY GROVE CHURCH

BRAMBLEGATE

SAPP

HAIRSTON

KELLY GROVE RD

HISTORY TRAIL

PANDORA DR

GUILFORD

DRAXWOOD ST

WYLER RD

SHAWLEY CT

WILSON

CHINNEY ROCK CT

ROANNE WAY

NICHOLAS RD

HORNADAY RD

WYLER RD

WILSON

CHINNEY ROCK RD

SWIGGERT RD

SWING

COLLEGE

WYLER RD

WILSON

CHINNEY ROCK RD

BURNT POPLAR RD

TRI-PORT CT

NILE PL

WYLER RD

WILSON

CHINNEY ROCK RD

AMERICAN AV

HUNTER CAMERON

FRIENDWAY CIR

WYLER RD

WILSON

CHINNEY ROCK RD

WOODSTREAM LN

WAGON TR

WYLER RD

WILSON

CHINNEY ROCK RD

GRASSY MEADOW RD

WAGON HOLLY

WYLER RD

WILSON

CHINNEY ROCK RD

COACK HILL

WAGON HOLLY

WYLER RD

WILSON

CHINNEY ROCK RD


BALLINGER

WAGON HOLLY

WYLER RD

WILSON

W

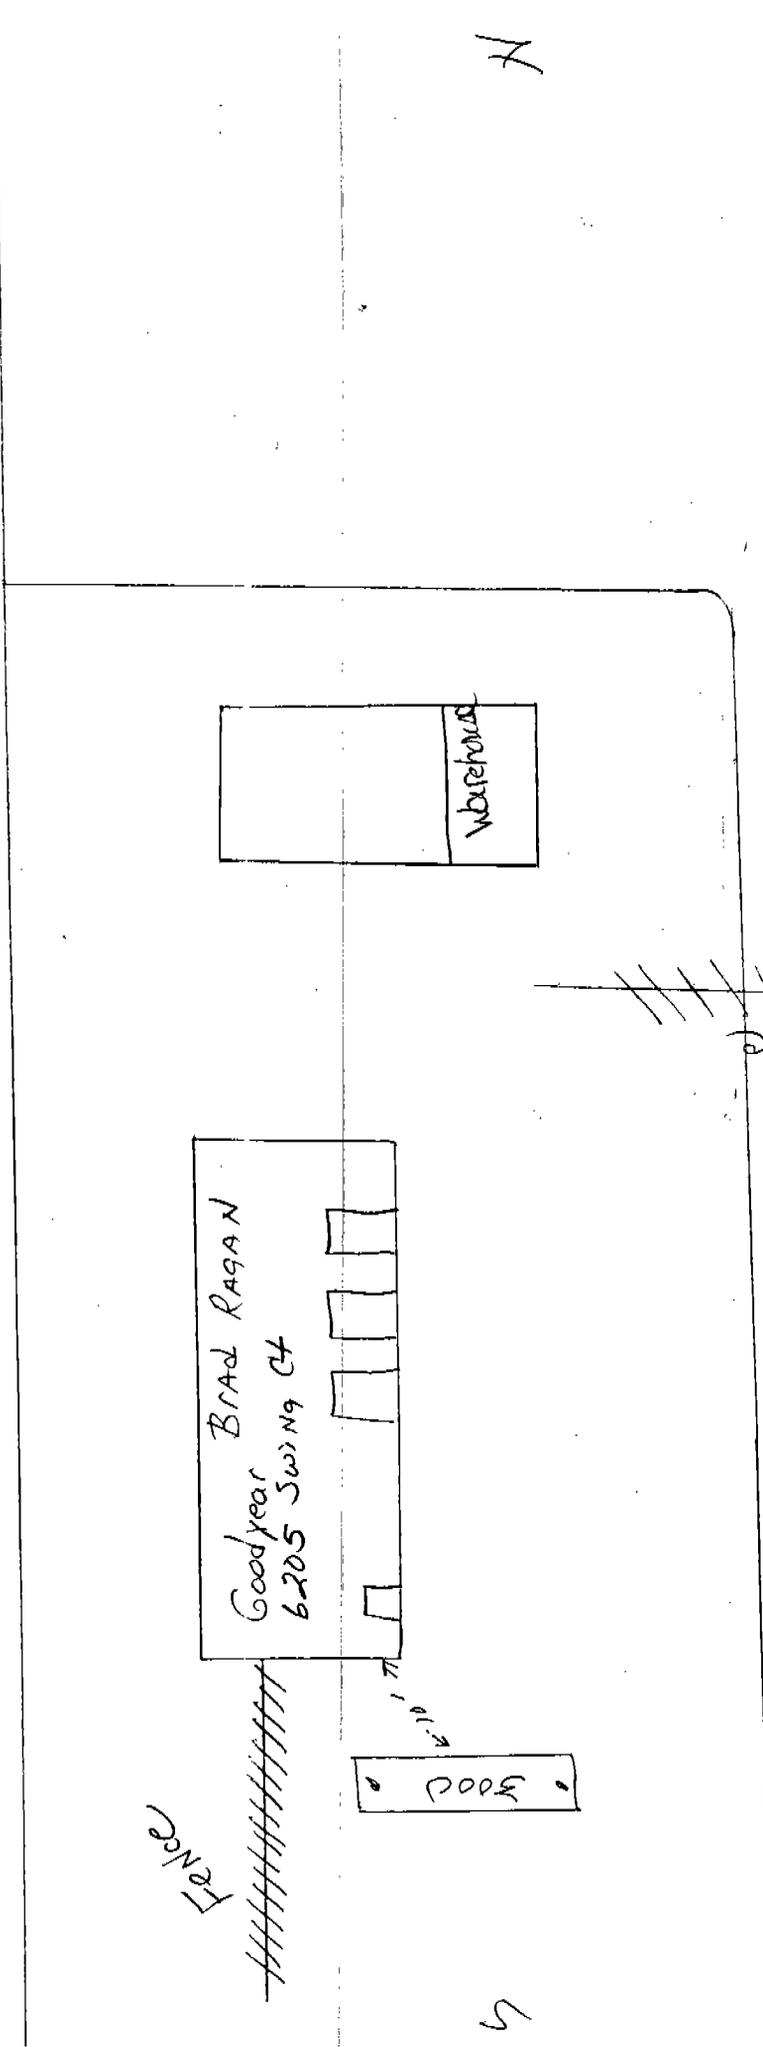

Fence

Goodyear
BRAD RAGAN
6205 SWING CT

5000

Warehouse

4

H

Fence

Warehouse

E

GREENSBORO FIRE DEPARTMENT
FIRE PREVENTION BUREAU
1514 N. Church Street
Greensboro, N. C. 27405
373-2177

11:00
Capt. *Seemee*

To: Chief of Fire Prevention Bureau, City of Greensboro, N. C.

Application is hereby made by the undersigned for a permit to

X Remove Underground Tank(s)

Abandon Underground Tank(s) in or on the premises know as:

Phillips Management 6205 Swing Ct. Greensboro NC
(Business Name and Address)

1. Tank Contractor: Bobbie's Backhoe Ser. Inc.
Contractor's Address: 1324 Wiley Lewis Rd. Greensboro NC
Number, size and product type of tanks: 1- 1000 GAS
2. Permit shall be obtained for the removal or abandonment of underground tanks in place prior to beginning work.
3. Tank contractor shall be licensed as a General Contractor by City Tax Collections.
4. Removal and abandonment of underground tanks in place shall comply with all applicable codes and regulations including the Fire Code, Guilford County Health Regulations, N.F.P.A. 327, and A.P.I. Publication 1604.
5. Notify Fire Prevention at 373-2177 and Guilford Environmental at 373-3771 prior to removal or abandonment in place. Removal or abandonment to be conducted Monday through Friday (no weekends or city holidays) between the hours of 8:00 a.m. - 4:00 p. m.).
6. For tank removal or abandonment in place all liquids shall be removed from the tank(s) and properly disposed of in accordance with applicable laws.
7. Prior to removal or abandonment in place tanks shall be purged or rendered inert. Purging or inerting shall be conducted in accordance with applicable standards and regulations. For purging the vapors shall not exceed 20% of the lower flammable limit. For inerting the oxygen content shall be below 8%. Tank contractor shall have the proper operating meters, combustible gas indicator and/or oxygen meter at each job site.

Note: Perchloroethylene will not be allowed as an inerting agent.

8. Tanks which have been removed from the ground shall be promptly removed from the premises to a proper facility. Tanks shall be labeled with legible letters at least 2 inches high similar to the following:

TANKS HAS CONTAINED LEADED GASOLINE
NOT VAPOR FREE
* NOT SUITABLE FOR STORAGE OF FOOD
OR LIQUIDS INTENDED FOR HUMAN OR ANIMAL CONSUMPTION
DATE OF REMOVAL; MONTH/DAY/YEAR

9. Tanks to be transported in accordance with all applicable Local, State and Federal regulations. Tank openings to be plugged or capped with one plug having a 1/8 inch vent hole to prevent the tank from being subjected to excessive differential pressure. Tanks to be secured on a truck for transportation to the storage or disposal site with the 1/8 inch vent hole located at the uppermost point on the tank.
10. Tank contractor shall complete and submit the attached Guilford County form upon completion of removal or abandonment of tanks. Information submitted to be accurate and detailed.

I understand and consent to the above stipulated conditions upon which this permit is granted. Failure to obtain permit and comply with regulations may render you liable to the penalties provided by Law.

Jeresa Dixon
Bobby's Backhoe Ser.
Applicant

Date: 6-7-93

Phone: Day 215/286 Night 215/286

Capt. J. D. ...
Inspector

Date: 6-7-93

Permit Granted Denied

cc. Guilford County Health Department