

MBH
②
RC

McAlister oil Company
222 Madison street

RECEIVED
N.C. Dept. of EHNR
FEB - 1 1996
Winston-Salem
Regional Office

January 29, 1996

Attention: Michael Amsbough
Environmental Management
585 Waughtown Street
Winston Salem, N.C.

Subject: Pascal's Texaco, Underground storage Tank, Closure Assessment
3038 US Hwy 158 Reidsville NC

Dear Mr. Amsbough:

In response to your letter dated January 11, 1996, Niemczura and Company, 163 Manley FM.Rd. Reidsville, N.C., was contracted to remove and dispose of this thousand gallon tank. See enclosed Tank Closure report furnished by Niemczura and Company.

The depth of the tank burial was thirty inches.

In September 1991 a new four thousand gallon tank was installed at this location to replace the said tank in question. The gasoline in the thousand gallon tank was pumped out into the new four thousand gallon tank, therefore there was no sludge.

I have enclosed a G.W./UST-2 " Site Investigation Report For Permanent Closure or Change-in-service of U.S.T."

Sincerely,



Harold E. Kendrick
Manager

FOR TANKS IN NC

Return Completed Form To: The appropriate DEM Regional Office according to the county of the facility's location. [SEE MAP ON REVERSE SIDE OF OWNER'S COPY (PINK) FOR REGIONAL OFFICE ADDRESS].

State Use Only I.D. Number Date Received

INSTRUCTIONS

Complete and return within (30) days following completion of site investigation.

I. Ownership of Tank(s)

II. Location of Tank(s)

McAlister Oil Company
Owner Name (Corporation, Individual, Public Agency, or Other Entity)
222 Madison Street
Street Address
Rockingham
County
Reidsville, N. C. 27320
City State Zip Code
910-342-3344
Area Code Telephone Number

Paschal's Texaco
Facility Name or Company
0-019369
Facility ID # (if available)
3038 US Hwy 158
Street Address or State Road
Rockingham Reidsville, N.C. 27320
County City Zip Code
910-349-8854
Area Code Telephone Number

III. Contact Person

Harold Kendrick Manager 910-342-3344
Name Job Title Telephone No. (Area Code)
Closure Contractor Joe Niemczura 163 Manley FM Road Reidsville, N.C. 910-349-4874
(Name) (Address) Telephone No. (Area Code)
Lab Water Tech & Controls Reidsville, N.C. 910-342-4748
(Name) (Address) Telephone No. (Area Code)

IV. U.S.T. Information

V. Excavation Condition

VI. Additional Information Required

Table with columns: Tank No., Size in Gallons, Tank Dimensions, Last Contents, Water In Excavation (Yes/No), Free Product (Yes/No), Notable Odor or Visible Soil Contamination (Yes/No). Row 1: 1, 1,000, 4'X10'6", gas, X, X, X.

See reverse side of pink copy (owner's copy) for additional information required by N.C. - DEM in the written report and sketch.

VII. Check List

Check the activities completed.

- Contact local fire marshal
Notify DEM Regional Office before abandonment
Drain & flush piping into tank
Remove all product and residuals from tank
Excavate down to tank
Clean and inspect tank
Remove drop tube, fill pipe, gauge pipe, vapor recovery tank connections, submersible pumps and other tank fixtures.
Cap or plug all lines except the vent and fill lines.
Purge tank of all product & flammable vapors.
Cut one or more large holes in the tanks.
Backfill the area.
Date Tank(s) Permanently closed: 11-25-93
Date of Change-in-Service:

- ABANDONMENT IN PLACE
Fill tank until material overflows tank opening;
Plug or cap all openings;
Disconnect and cap or remove vent line
Solid inert material used - specify:

- REMOVAL
Create vent hole
Label tank
Dispose of tank in approved manner
Final tank destination: Griffin Sal.

VIII. Certification (Read and Sign)

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this and all attached documents, and that based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the submitted information is true, accurate, and complete.

Print name and official title of owner or owner's authorized representative Signature Date Signed
McALISTER OIL COMPANY BY: HAROLD KENDRICK Harold I. Kendrick 12-21-93



NIEMCZURA and COMPANY

**Petroleum Equipment Installation
Backhoe Service**

163 Manley Farm Road

Reidsville, North Carolina

(919) 349-4874

JOE NIEMCZURA

GW/UST-2

DEHNR

8025 N.POINT BLVD.

SUITE 100

WINSTON-SALEM, N.C.

27106-3203

TANK CLOSURE REPORT

ON:

PASCHALS GROCERY

3038 HWY.158

REIDSVILLE, N.C.

ROCKINGHAM COUNTY

I.D. # 0-019369

(2)

MCALISTER OIL CO. OF REIDSVILLE, N.C. EMPLOYED NIEMCZURA AND CO. TO REMOVE A 1,000 GALLON TANK FROM PASCHALS GROCERY. BEFORE ANY WORK WAS STARTED THE DEHNR AND ROCKINGHAM COUNTY FIRE MARSHALL, STEVE HALE WAS CONTACTED. ABOUT THE REMOVAL OF THE TANK. THE TANK HAD NOT BEEN IN SERVICE SINCE 1991. THE TANK WAS A GAS TANK BUT USED TO BE A KEROSENE TANK. THE PUMP WAS LOCATED NEXT TO THE TANK HOLE.

THE TANK SIZE WAS 4'x10'6". THE FILL LINE WAS 30" LONG. THERE WAS NO GROUNDWATER OR AN ODER DURING THE REMOVAL. THE TANK DID NOT HAVE ANY HOLES AND VERY LITTLE PITTING.

SOIL SAMPLES WERE TAKEN TWO FEET BELOW THE TANK NEAR EACH END OF THE TANK. A ONE INCH BY THREE INCH STAINLESS CYLINDER WAS DRIVEN INTO THE SOIL TO OBTAIN THE SAMPLES. THE SAMPLES WERE THEN SEALED AND AND LABLED AND PACKED ON ICE TO BE TAKEN TO THE LAB.


WATER TECHNOLOGY AND CONTROLS OF REIDSVILLE, N.C. PERFORMED THE SOIL TESTING. THE RESULTS OF THE TEST AND THE LOCATION OF THE SAMPLES ARE ENCLOSED.

A SITE MAP AND MAP OF ROCKINGHAM COUNTY ARE ENCLOSED.

DRY ICE WAS PUT INTO THE TANK AND THE OXYGEN LEVEL WAS 6.2
THE TANK WAS CUT UP AND DISPOSED OF BY NIEMCZURA AND CO,

NIEMCZURA & CO.

Joe Niemczura
JOE NIEMCZURA



WATER TECHNOLOGY AND CONTROLS, INC.
 Water Treatment Chemistries & Environmental Laboratory
 Reidsville, North Carolina 27320
 (919) 342-4748

CHAIN OF CUSTODY RECORD

Customer AMMUNIZURA & CO Phone (919) 349-9879
 Contact Joe Niemczura
 Sampler (Signature) Joe Niemczura

TO BE
 FILLED IN
 ONLY AT
 LABORATORY

Sample Location	Sample Collection			Sample Type			Number of Containers Shipped	Test(s) Required	Preservation	
	Date 1	Time	Date 2	Time	Composite				Icing O.K.?	pH O.K.?
					Auto	Hand				
PASCALS GROVE	11-8-93	9:40A	KERO I		✓		1	5030-KERO		
"	11-8-93	10:20A	KERO II		✓		1	5030 KERO		
Relinquished by: (Signature)								Date & Time		
<u>Joe Niemczura</u>								11/19/93		
Received for WT&C by:								Date & Time		
<u>Joe Niemczura</u>								11/19/93		
Received at lab by:								Date & Time		
<u>Joe Niemczura</u>								11/19/93		

825



Water Technology and Controls, Inc.
Water Treatment Chemistries & Environmental Laboratory
Reidsville, North Carolina 27320
(919) 342-4748

WT&C Sample ID: 11099305
Client: Niemczura & Co.
Client ID: Paschals Groc., Kero I

Analyte	Concentration	Date Analyzed	Method
Total Gasoline Range Hydrocarbons	< 10 mg/kg	11-09-93	California TPH by 5030
Total Kerosene Range Hydrocarbons	< 10 mg/kg	11-11-93	California TPH (LUFT, 1989)



Water Technology and Controls, Inc.
Water Treatment Chemistries & Environmental Laboratory
Reidsville, North Carolina 27320
(919) 342-4748

WT&C Sample ID: 11099306
Client: Niemczura & Co.
Client ID: Paschals Groc., Kero II


Analyte	Concentration	Date Analyzed	Method
Total Gasoline Range Hydrocarbons	< 10 mg/kg	11-09-93	California TPH by 5030
Total Kerosene Range Hydrocarbons	< 10 mg/kg	11-11-93	California TPH (LUFT, 1989)

Fill line \$
30" Long

TANK SIZE
48" x 10'6"
Samples Taken
8'6" deep



The depth of tank
burial was 2'6"

6/99

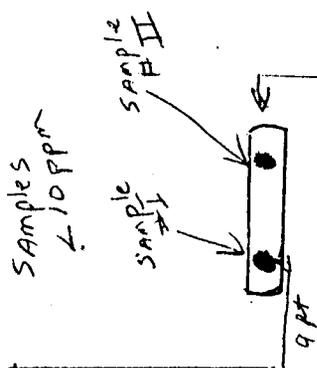

PASCHAL'S GROCERY
3038 US 158
Reidsville, N.C.
I.D. # 0-0A369

APPROXIMATE
9220K
KEY
TAP

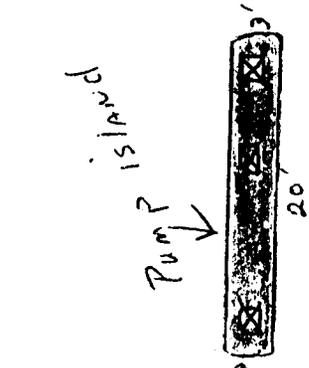


TANK FARM

DRIVE

DRIVE

Yanceville ← Hwy 158 → To Reidsville

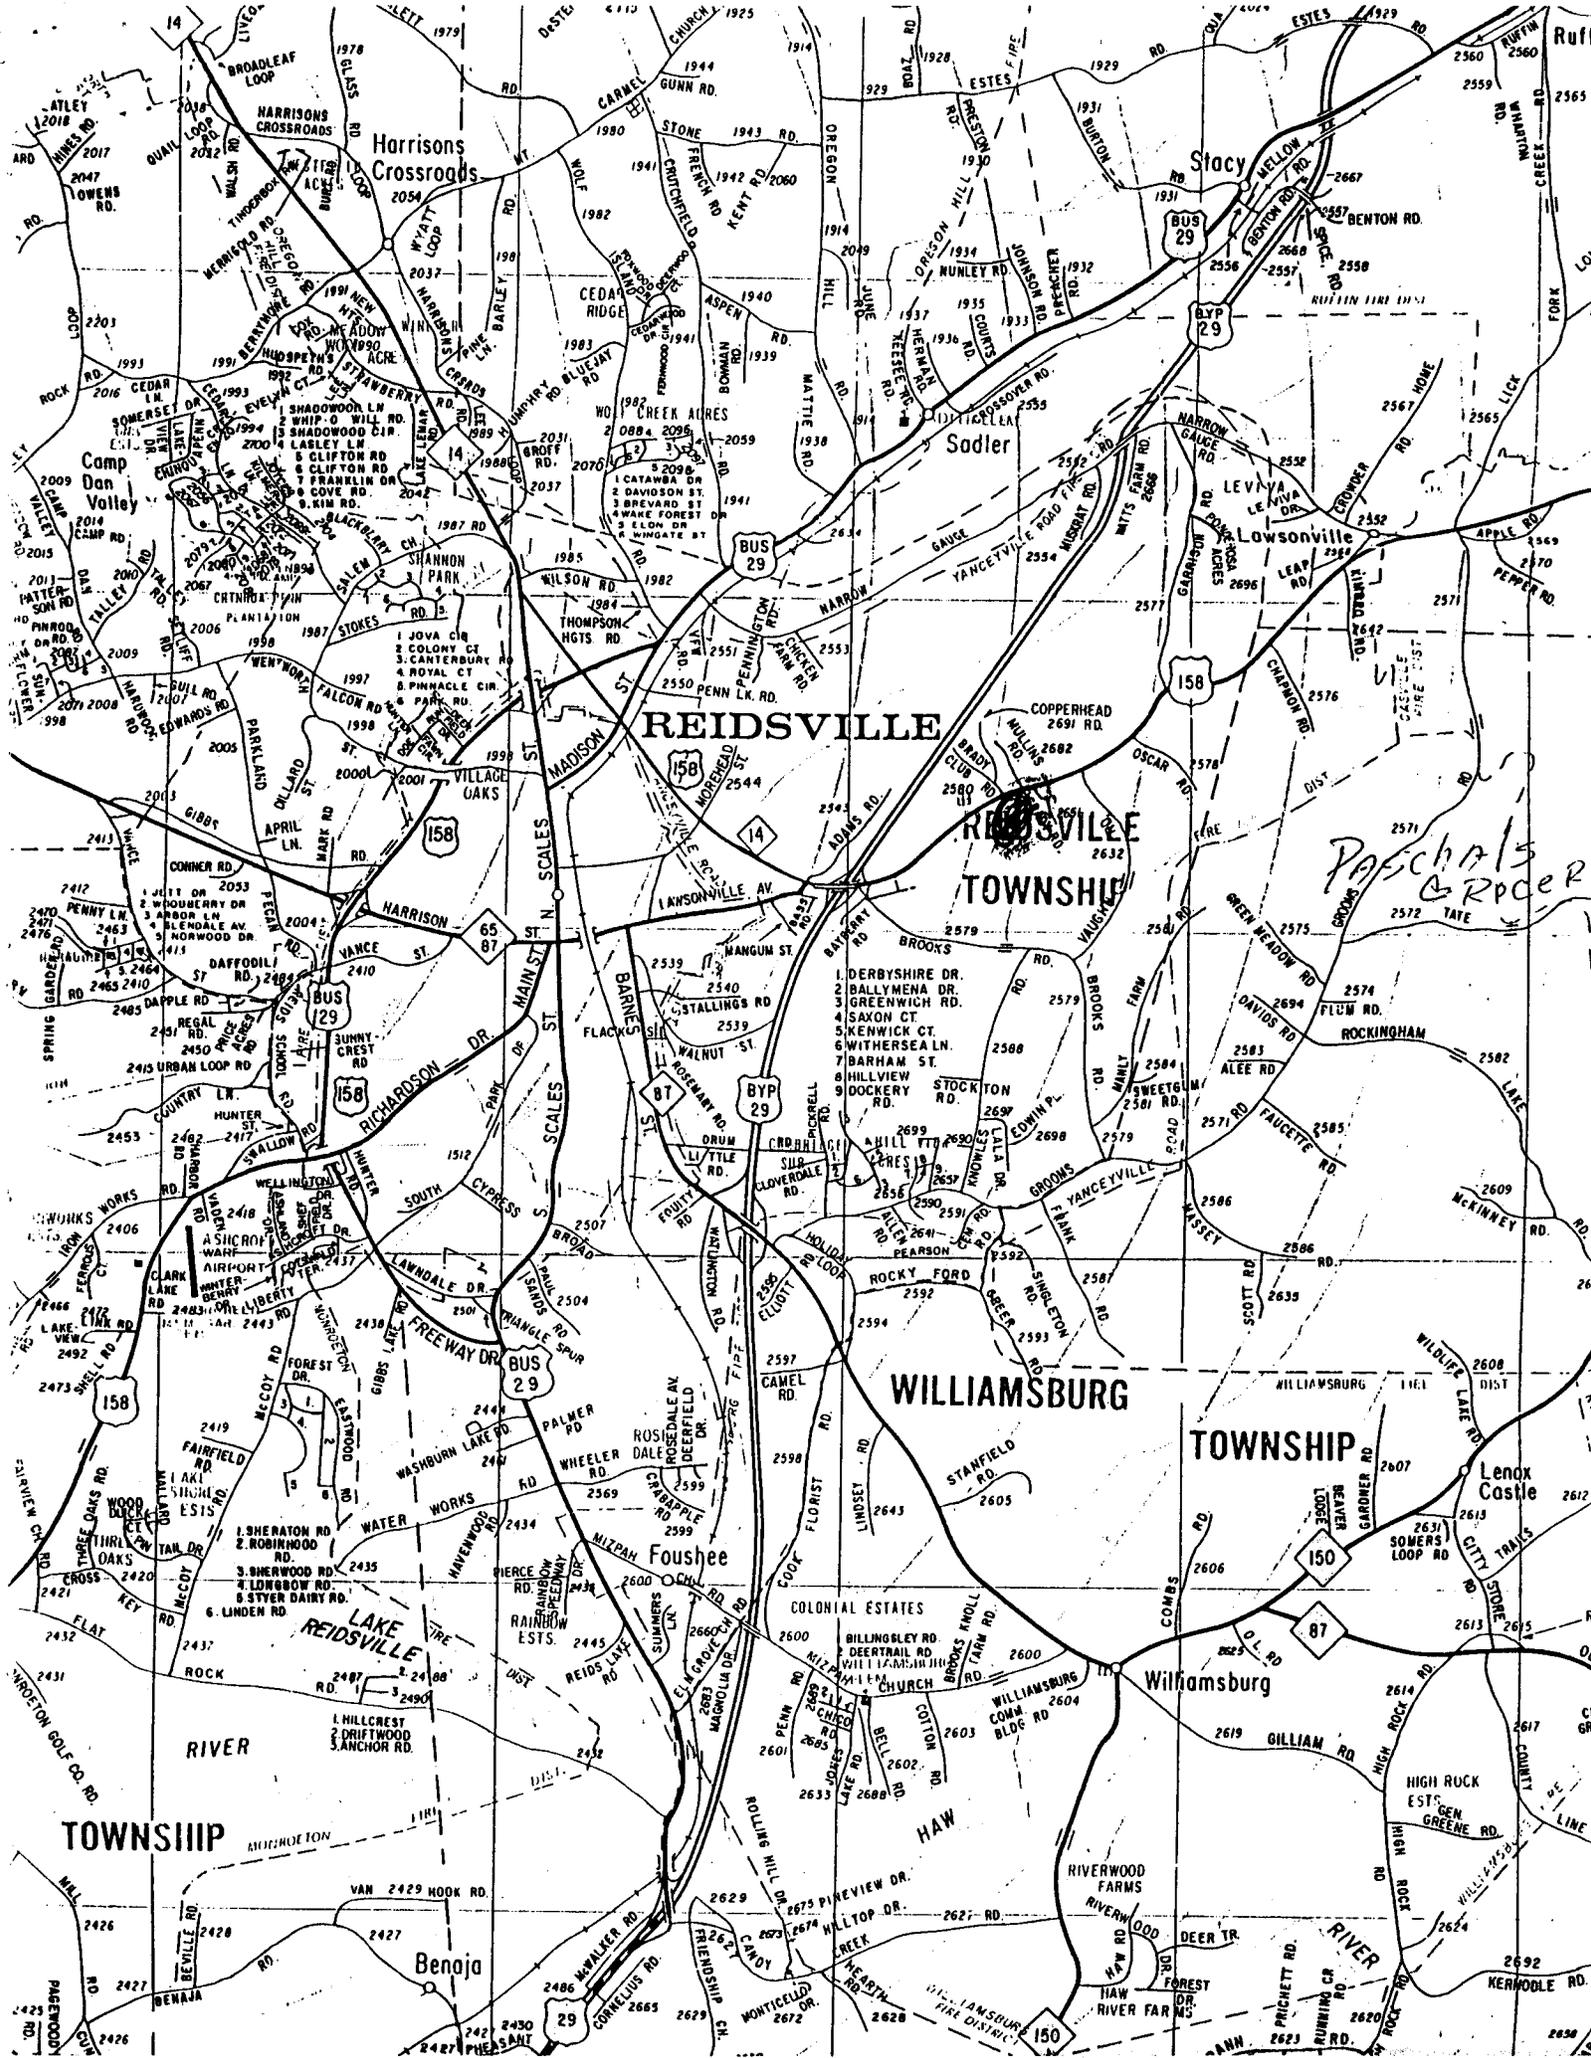

Harrison Crossroads

Stacy

REIDSVILLE

ROSSVILLE
TOWNSHIP

WILLIAMSBURG

TOWNSHIP

TOWNSHIP

Williamsburg

Benaja

Paschals Gruber

Lenox Castle

Foushee

RIVERWOOD FARMS

HIGH ROCK EST.

